



An independent family business since 1867

# Piccolo FX Structure

Vertical platform lift with hydraulic drive & cabin with automatic sliding doors in FX Structure (shaft by others)

# Stannah

### Specifications:

Rated Load: 400kg, 5 Person  
 Rated Speed: 0.15m/s  
 Maximum Travel: 12m  
 Maximum number of stops: 5  
 Pit Depth: 150mm  
 Minimum Headroom: 2500mm  
 Cabin internal dimensions: CW x CD x 2000 high  
 Doors: Automatic 2 panel side opening, DO x 2000 high  
 Controls: Latched call controls as standard.

Cabin Size CW x CD (Note 3)	Door Opening DO	Door Config	Min Plumb Shaft Size (+50/-0)		Structural Opening SO	X	Y
			SW	SD			
1100 x 1400	900	Single	1720	1820	1160	485	75
		Through		1960			
950 x 1400	800	Single	1570	1820	1060	435	75
		Through		1960			
950 x 1250	800	Single	1570	1670	1060	435	75
		Through		1810			

### Notes:

- All dimensions in mm unless stated.
- Minimum floor to floor dimensions:
  - between consecutive floors on same side = 2400mm minimum
  - between consecutive floors on opposing sides = 180mm minimum
  - between terminal floors = 1000mm minimum
- 1100 x 1400 cabins are Part M (England & Wales) and section 4.2 of the Technical Handbook (Scotland) compliant, 950 x 1400 cabins are Part M (England & Wales) compliant.
- Range of cabin finishes available, please contact us for further information.

### Electrical Requirements:

- Provide a dedicated single phase supply protected by a 16amp type D MCB. The lift supply is to terminate in a lockable isolator at a position shown on builders work diagram.
- Provide a 13amp electrical outlet socket adjacent to the lift installations at all levels. The supply to these sockets is not to be derived from the lift supply detailed in Note 5 above.
- Ensure that lighting at all landing levels is not less than 50lux.

### Fixings:

- Nominal loads are transmitted through the FX Structure to all four shaft walls, at each landing level and in the headroom. Vertical loads are transmitted to the pit base - refer to relevant 'Loads & Fixings' information sheet or site specific Builders Work Drawing for details.
- It shall be the customer's responsibility to ensure suitability of the building structure for the applied loads, both in terms of strength & also suitability of the fixings proposed. If any doubts exist, it is advised that a structural engineer is consulted.

### Drive Unit:


- The drive unit is housed in a separate enclosure, which should be located within 5m of the base of the lift (guide side).

### Scaffolding:

- Scaffolding is not required for an FX Structure.

### Structural Openings:

- Lowest landing: front wall nib (X) to be left down to permit installation of lift equipment, i.e. structural opening = X + SO  
 All other landings: structural opening = SO (see 'Plan View')

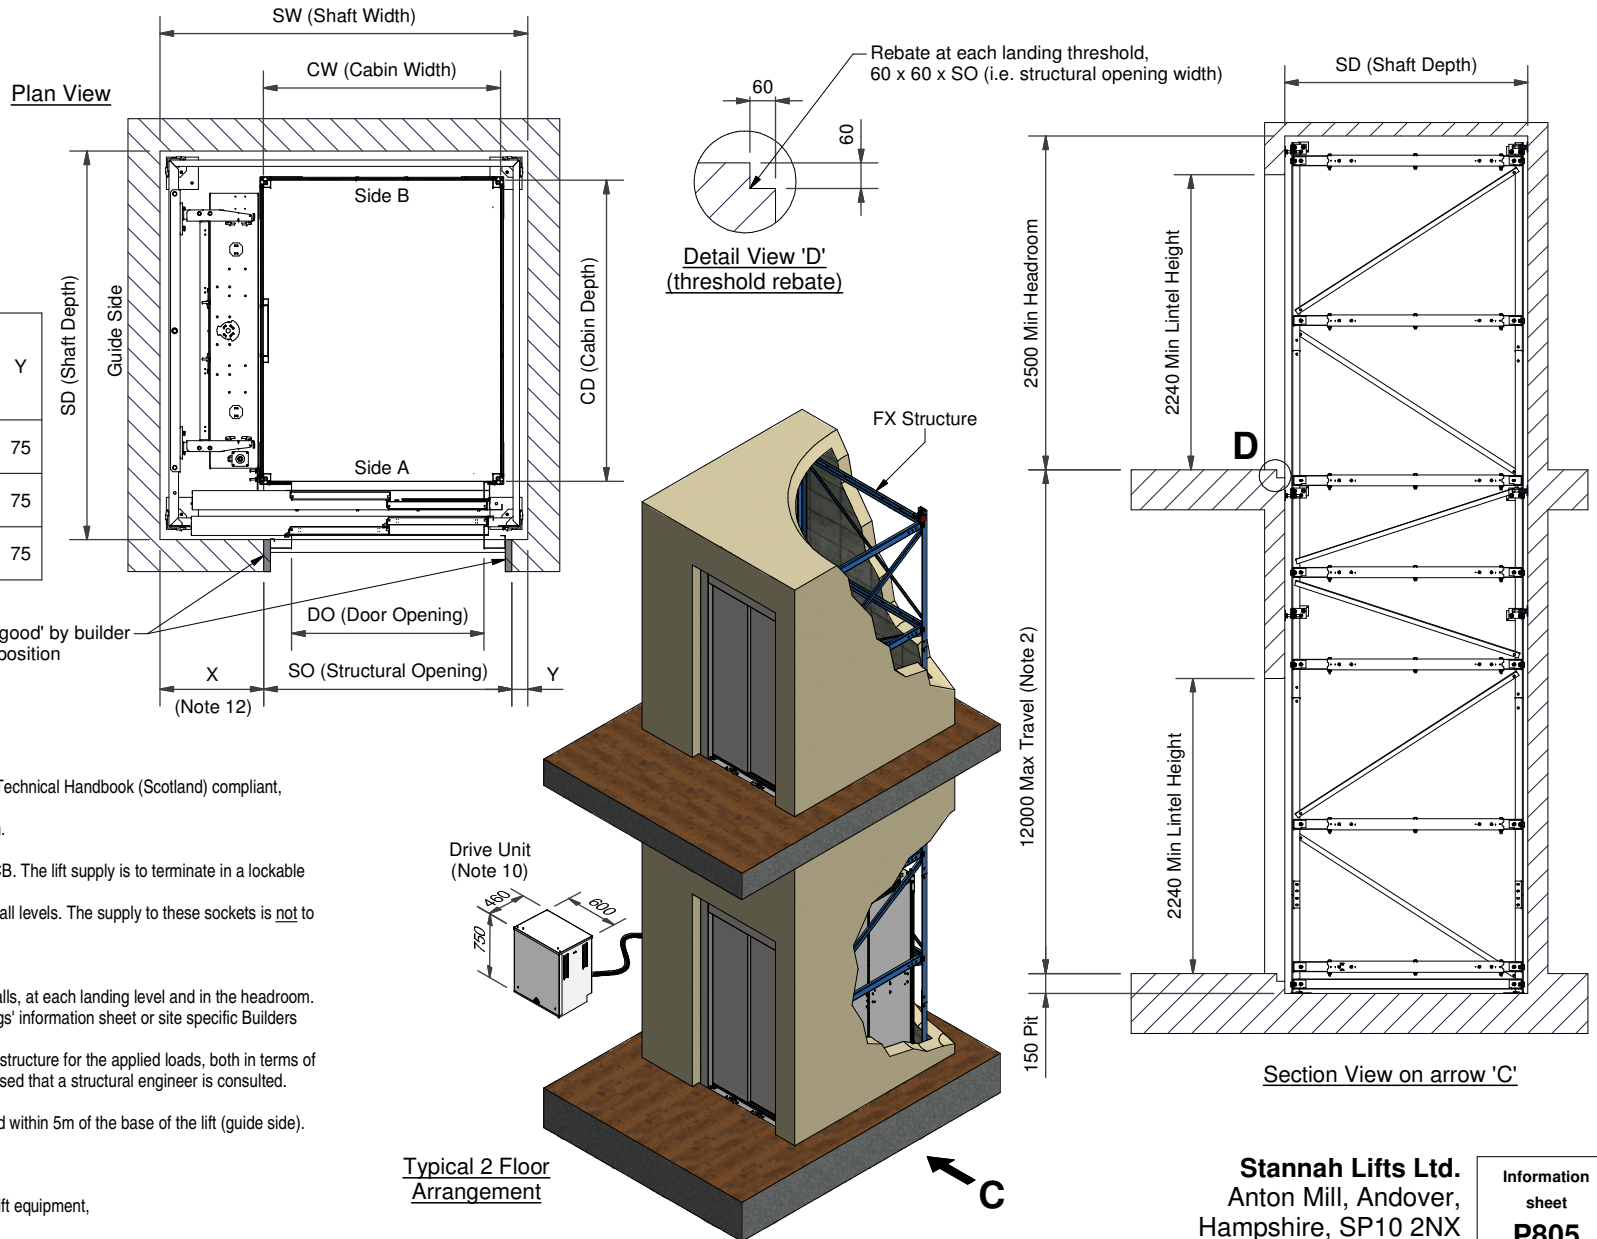

Typical 2 Floor Arrangement

Waiver

The data sheet is for guidance only & must not be used for proper working drawings. Please contact us for particular details before proceeding. Owing to our policy of continual improvement, we reserve the right to alter specifications & dimensions without prior notice.

**Stannah Lifts Ltd.**  
 Anton Mill, Andover,  
 Hampshire, SP10 2NX  
 Tel: 01264 339090  
 www.stannahlifts.co.uk

Information sheet  
**P805**  
 30/01/2018