NOTES:

1. PROVIDE A DEDICATED 230V AC 50Hz SINGLE PHASE SUPPLY (INCLUDING EARTH) TERMINATING IN A DOUBLE POLE SWITCH PROTECTED BY A 13 AMP FUSE AND RESIDUAL CURRENT DEVICE (RCD).

SWITCH TO BE LOCATED IN CLOSE PROXIMITY TO CONTROL CABINET & PREFERABLY OUT OF SIGHT TO DICOURAGE TAMPERING BUT WITHIN CLOSE PROXIMITY TO CONTROL CABINET AS REASONABLY POSSIBLE.

2. PROVIDE A 13A ELECTRICAL OUTLET SOCKET ADJACENT TO THE LIFT (NOTE: THE SUPPLY TO THE OUTLET SOCKET IS NOT TO BE INTERRUPTED BY THE DOUBLE POLE SWITCH REQUESTED IN '1')

3. ENSURE THAT LIGHTING AT BOTH FLOOR LEVELS IS NOT LESS THAN 50 LUX.

4. CONDUITS TO BE SUPPLIED AND SURFACE FIXED AS PART OF INSTALLATION. CONDUITS WIL BE ARRANGED GENERALLY AS SHOWN OR TO SUIT SITE CONDITIONS.

5. CONTROL CABINET WILL BE POSITIONED ACCORDING TO CUSTOMER'S REQUIREMENT WITHIN CONSTRAINT OF ACHIEVING EASY ACCESS FOR MAINTENANCE.

6. UPPER LEVEL CALL POINT TO BE POSITIONED 1500mm MIN FROM TOP LANDING IN ORDER TO AVOID HAZARD OF EXPOSING USER TO POSSIBILITY OF FALLING DOWN STAIRS DURING THE PROCESS OF CALLING LIFT.

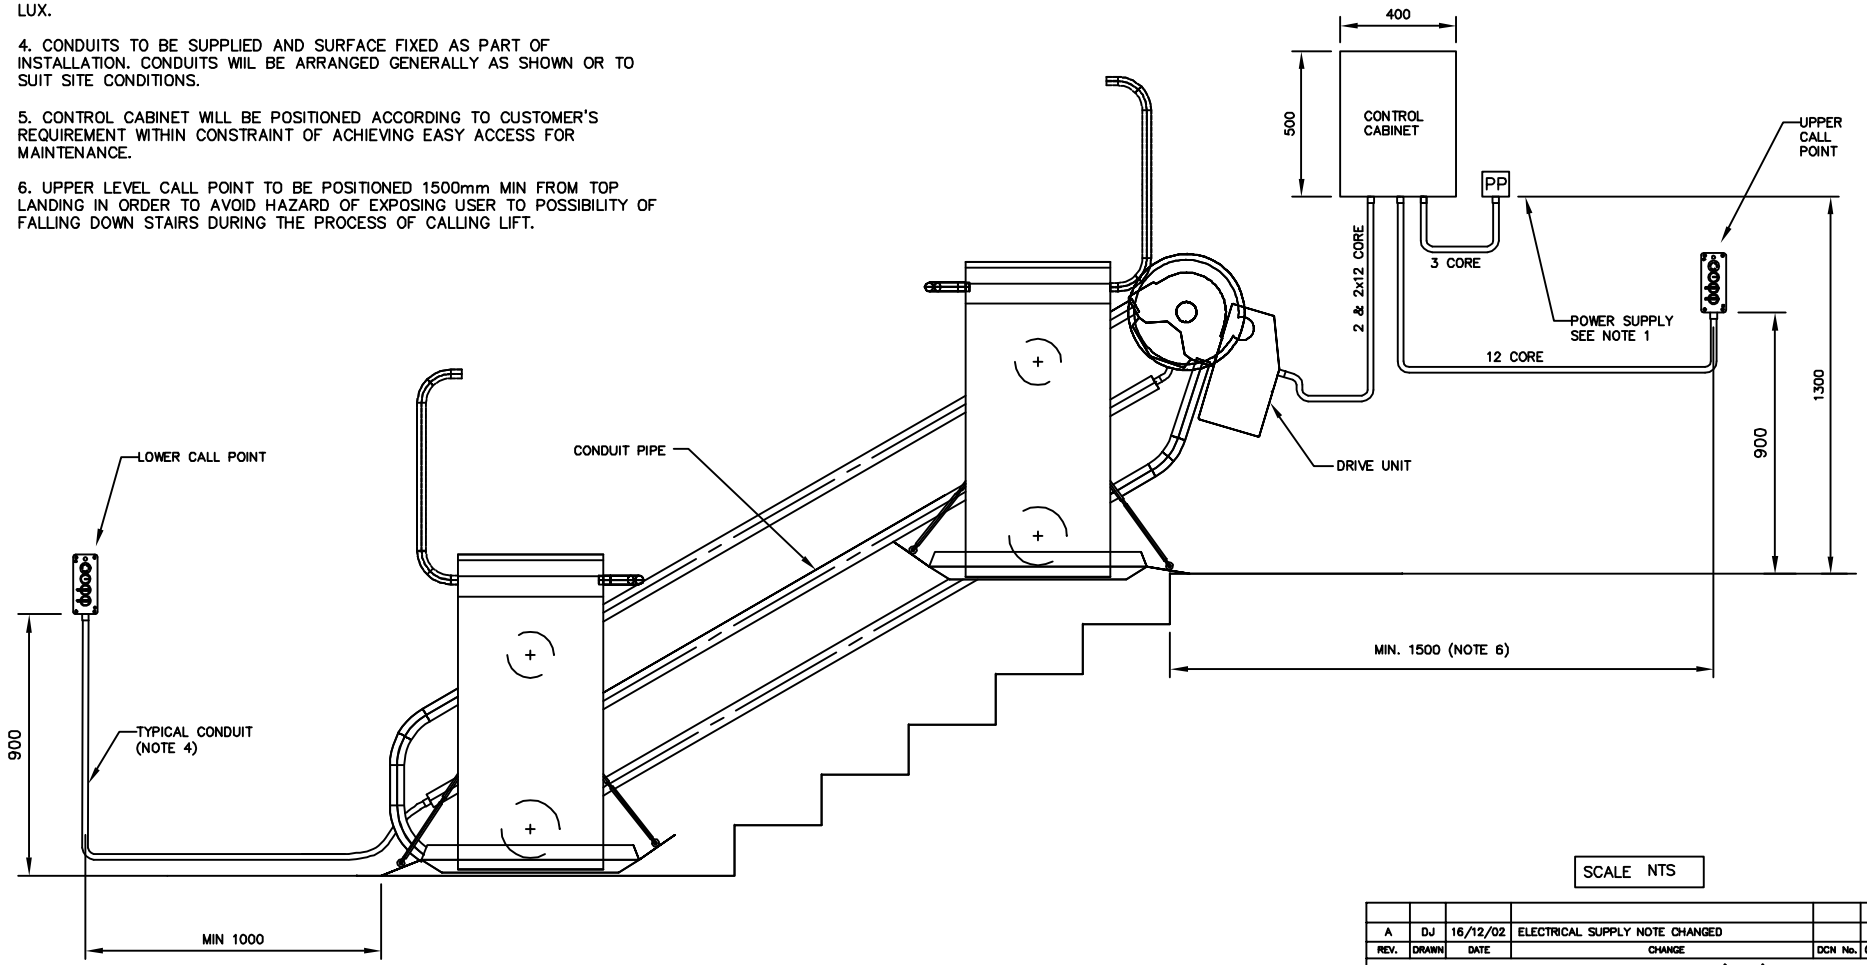

SCALE NTS

REV.	DRAWN	DATE	CHANGE	DCN No.	GRID REF.
A	DJ	16/12/02	ELECTRICAL SUPPLY NOTE CHANGED		

DRG TITLE: WIRING, STAIRISER 'CR'

Stannah Lifts
HEAD OFFICE
Anton Mill, Andover,
Hampshire, SP10 2NX. England
Tel: 01264 336090 Fax: 01264 361552
E-Mail Address: jon_hatt@stannah.co.uk

MATERIAL: –
FINISH: –
DRAWN BY: CPD DATE: 28.11.01
CHECKED BY: –
DRAWING NUMBER: CR213000
REV. A