


## 2. General Description

### Typical Machine Room Layout

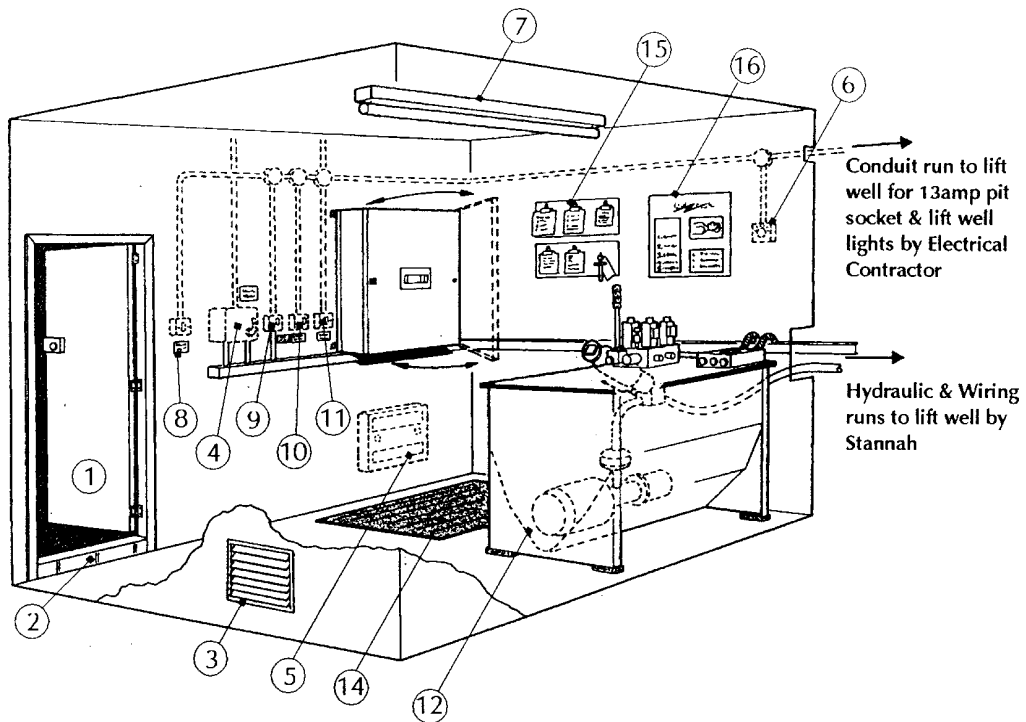

#### Requirements provided by building Contractor

1. Access door min. 800mm wide with Yale type lock. Door to open outwards.
2. Anti-spillage barrier 100mm high, painted white.
3. Ventilation grill.

#### Requirements provided by Electrical Contractor

4. Independent power supply to main triple pole switch fuse. Position 1400mm to underside from FFL.
5. Heater to maintain ambient temperature between +15°C and 30°C.
6. Room Thermostat.
7. Machine room lighting (2 hour emergency).
8. Machine room light switch.
9. Fused spur box for lift car lighting.
10. Lift well lighting switch.
11. 13amp switch socket.

#### Equipment supplied by Stannah Lifts Ltd

12. Hydraulic pump unit.
13. Lift control panel.
14. Rubber matting.
15. Notice-board with emergency release key.
16. Electric shock treatment instructions.